### **TEST REPORT**



#### AS 60529

# Degrees of protection provided by enclosures (IP Code)

Test Report

Tested by (+ signature)...... Trevor Patrick

ASSOCIATE PROJECT ENGINEER

Approved by (+ signature) ...... Stuart Foster

STAFF ENGINEER

Date of testing...... February 2013

Contents...... 18 pages

Laboratory details

Name ...... UL International New Zealand Ltd

Test specification

Standard..... AS 60529 – 2004

Client details

Applicant ...... LAKE PRODUCTS Ltd

Product details (see additional details on page 3)

Type of test object ...... Electrical Enclosures with self-sealing wall boot

Model/type reference ...... Pipetite Grommet 0-90

Pipetite Grommet 70-135

Rating.....: NA

#### Accreditation details





International Accreditation New Zealand (IANZ) has a Mutual Recognition Agreement (MRA) with the National Association of Testing Authorities, Australia (NATA) such that both organisations recognise accreditations by IANZ and NATA as being equivalent.



All tests reported herein have been performed in accordance with the laboratory's scope of accreditation

TRF revision 121218

Page: 2 of 18

#### Possible results

#### General remarks

"(see remark #)" refers to a remark appended to the report.

"(see appended table)" refers to a table appended to the report.

"(see appended results)" refers to results appended to the report.

The test results presented in this report relate only to the samples tested.

The test samples were provided by the client and were tested as submitted.

All measurements within this test report are made using instruments with an accuracy in accordance with IECEE CTL Decision Sheet DSH 251B. Details of specific measurement uncertainty are available upon request.

This report does not contain corrections or erasures.

This report shall not be reproduced except in full without the written approval of the testing laboratory.

#### Specific remarks

Model Pipetite Grommet 0-90 was supplied fitted to a 50 mm pipe and enclosure.

Model Pipetite Grommet 70-135 was supplied fitted to a 90 mm pipe and enclosure.

Both samples were tested as supplied.

#### Statement of results

The test samples were assessed for a classification of IP64 in accordance with the test specification.

The test samples COMPLY with the tests for a classification of IP64.



E:: enquiries@nz.ul.com / W:: nz.ul.com

Page: 3 of 18

Product details	
Enclosure classification:	IP64
Enclosure type:	thermoplastic / metal
Conductor entry:	none
Product mass:	See appended table
Product dimensions:	See appended table
Marking details	
No marking	



Page: 4 of 18

	AS 60529			
Clause	Requirement – Test	Remark	Result	
1.	SCORE AND OR IFOT		Lucren	
1.	SCOPE AND OBJECT		NOTED	
2.	NORMATIVE REFERENCES		NOTED	
3.	DEFINITIONS		NOTED	
4.	DESIGNATIONS			
5.	DEGREES OF PROTECTION AGAINST ACCESS TO HAZARDOUS PARTS AND AGAINST SOLID FOREIGN OBJECTS INDICATED BY THE FIRST CHARACTERISTIC NUMERAL			
6.	DEGREES OF PROTECTION AGAINST INGRESS OF WATER INDICATED BY THE SECOND CHARACTERISTIC NUMERAL			
7.	DEGREES OF PROTECTION AGAINST ACCESS TO HAZARDOUS PARTS INDICATED BY THE ADDITIONAL LETTER			
8.	SUPPLEMENTARY LETTERS			
9.	EXAMPLES OF DESIGNATIONS WITH THE IP CO	DDE	NOTED	
10.	MARKING		NOTED	
	Requirements for marking given in relevant product standard			
11.	GENERAL REQUIREMENTS FOR TESTS			
12.	TESTS FOR PROTECTION AGAINST ACCESS TO HAZARDOUS PARTS INDICATED BY THE FIRST CHARACTERISTIC NUMERAL			
12.1	Access probes as per Table 6		NOTED	
12.2	Test conditions			
	Access probe pushed against or inserted through any openings of the enclosure with a test force as specified in Table 6		Р	
	Access probe	1.0 mm (Ø) x 100 mm wire		
	Test force	1.0 N		



Page: 5 of 18

	AS 60529				
Clause	Requirement – Test	Remark	Result		
12.3	Acceptance conditions				
	Adequate clearance kept between the access probe and hazardous parts		N		
	For the test of numeral 1; access probe does not completely pass through the opening		N		
	For the test of numeral 2; jointed test finger may penetrate but stop face does not pass through the opening		N		
12.3.1	For low voltage equipment (rated voltage not exceeding 1000V ac and 1500V dc); access probe does not touch hazardous live parts				
12.3.2	For high voltage equipment (rated voltage exceeding 1000V ac and 1500V dc); equipment withstands dielectric strength tests as specified in the product standard with the access probe in the most unfavourable position		N		
	Verification by dielectric strength test or inspection of the clearance distance in air		N		
12.3.3	Access probe does not touch hazardous mechanical parts		Р		
havene			Р		
13.	TESTS FOR PROTECTION AGAINST SOLID FOREIGN OBJECTS INDICATED BY THE FIRST CHARACTERISTIC NUMERAL				
13.1	Test means and main test conditions as per Table 7		Р		
13.2	Test conditions for first characteristic numerals 1, 2, 3, 4				
	Object probe pushed against any openings of the enclosure with a test force as specified in Table 7		N		
	Object probe				
	Test force				
13.3	Acceptance conditions for first characteristic numeral	s 1, 2, 3, 4	N		
	Full diameter of the object probe does not pass through any opening				
13.4	Dust test for first characteristic numerals 5 and 6				
	Test made using dust chamber as per Figure 2		Р		
	Category 1 – with underpressure		Р		
	Category 2 – without underpressure		N		



Page: 6 of 18

	AS 60529				
Clause	Requirement – Test	Remark	Result		
2000 DES			T		
13.5	Special conditions for first characteristic numeral 5		N		
13.5.1	Test conditions for first characteristic numeral 5		N N		
13.5.2	Acceptance conditions for first characteristic numeral 5				
	Talcum powder not accumulated in quantity or location such as could interfere with correct operation or impair safety		N		
	No dust deposited where it could lead to tracking along creepage distances		N		
13.6	Special conditions for first characteristic numeral 6		Р		
13.6.1	Test conditions for first characteristic numeral 6	Category 1	Р		
13.6.2	Acceptance conditions for first characteristic numeral 6				
	No deposit of dust is observable inside the enclosure				
14.	TESTS FOR PROTECTION AGAINST WATER INDICATED BY THE SECOND CHARACTERISTIC NUMERAL				
14.1	Test means and main test conditions as per Table 8				
14.2	Test conditions				
	Tests conducted with fresh water as specified		Р		
	Water temperature	18°C			
14.2.1	Test for second characteristic numeral 1 with the drip box		N		
	Enclosure placed in normal operating position on turntable		N		
	Enclosures normally fixed to wall or ceiling fixed in normal position		N		
	Water flow rate		la lucius		
	Test duration		Small		
14.2.2	Test for second characteristic numeral 2 with the drip box		N		
	Enclosure placed in normal operating position in four positions of 15° tilt		N		
	Enclosures normally fixed to wall or ceiling fixed in normal position		N		
	Water flow rate				
	Test duration		Mark Indi		



Page: 7 of 18

AS 60529					
Clause	Requirement – Test	Remark	Result		
14.2.3	Test for second characteristic numeral 3 with the oscillating tube or spray nozzle		N		
	Test means				
	Enclosures subjected to spraying water through angle of 120°, 60° either side of vertical		N		
	Water flow rate				
	Test duration				
14.2.4	Test for second characteristic numeral 4 with the oscillating tube or spray nozzle		Р		
	Test means	oscillating tube	Starte		
	Enclosures subjected to spraying water through angle of almost 360°, 180° either side of vertical		Р		
	Water flow rate	0.07 I/min per hole			
	Test duration	10 min	rd : 10		
14.2.5	Test for second characteristic numeral 5 with the 6.3 mm spray nozzle		N		
	Enclosure sprayed from all practicable directions with test nozzle as per Figure 6		N		
	Water flow rate		A-CAR		
	Test duration				
14.2.6	Test for second characteristic numeral 6 with the 12.5 mm spray nozzle		N		
	Enclosure sprayed from all practicable directions with test nozzle as per Figure 6		N		
	Water flow rate		-4.55		
	Test duration				
14.2.7	Test for second characteristic numeral 7		N		
	Enclosure immersed in water as specified		N		
	Depth of immersion				
	Test duration		V T (18)		
14.2.8	Test for second characteristic numeral 8		N		
	Enclosure immersed in water as specified		N		
	Depth of immersion				
	Test duration				



Page: 8 of 18

AS 60529					
Clause	Requirement – Test Remark				
440	Accordance conditions		l P		
14.3	Acceptance conditions				
	No water entered enclosure; or  If water has entered:		P N		
	Not sufficient to interfere with correct operation of the equipment or impair safety		N		
	Not deposited on insulation parts where it could lead to tracking along creepage distances		N		
	Not reach live parts or windings not designed to operate when wet		N		
	Not accumulate near cable end or enter cable		N		
	Enclosure provided with drain holes; any water which enters does not accumulate and drains away		N		
	Enclosure without drain holes, water cannot accumulate to reach live parts		N		
15.	TESTS FOR PROTECTION AGAINST ACCESS TO HAZARDOUS PARTS INDICATED BY THE ADDITIONAL LETTER				
15.1	Access probes as per Table 6				
15.2	Test conditions		N		
	Access probe pushed against any openings of the enclosure with a test force as specified in Table 6		N		
	Access probe				
	Test force				
	Stop face does not penetrate through any opening		N		
15.3	Acceptance conditions		N		
	Adequate clearance kept between the access probe and hazardous parts		N		
	For the test of additional letter B; jointed test finger may penetrate but stop face does not pass through the opening		N		
	For the test of additional letters C and D; access probe may penetrate to full length but stop face does not pass through the opening		N		



Page: 9 of 18


MODEL REFERENCE TABLE				
Clause	Requirement – Test	Remark	Result	

Model	Height mm	Width mm	Depth mm	Mass kg
Pipetite Grommet 0-90	150	150	205	2.5
Pipetite Grommet 70-135	200	200	220	2.0


<sup>\*</sup> Dimensions and mass as per sample supplied for testing and includes electrical enclosure.



Page: 10 of 18

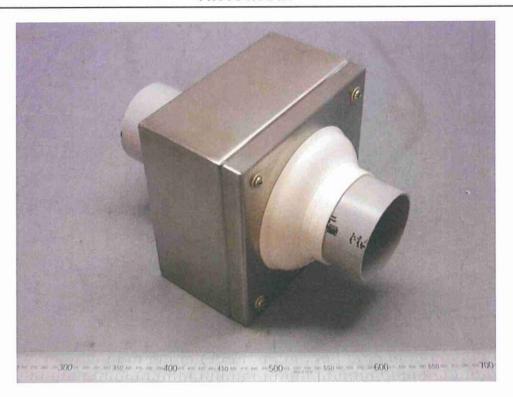


External View Pipetite Grommet 70-135 Wall Boot with 90mm Pipe

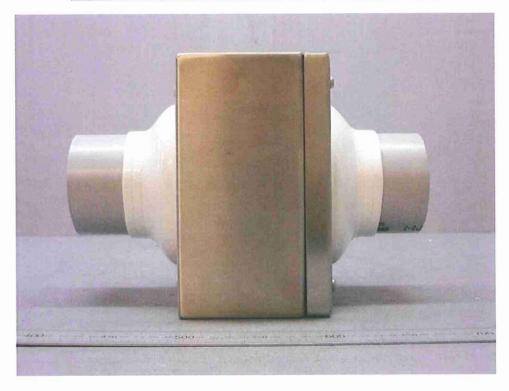


**External Side View** 



Page: 11 of 18

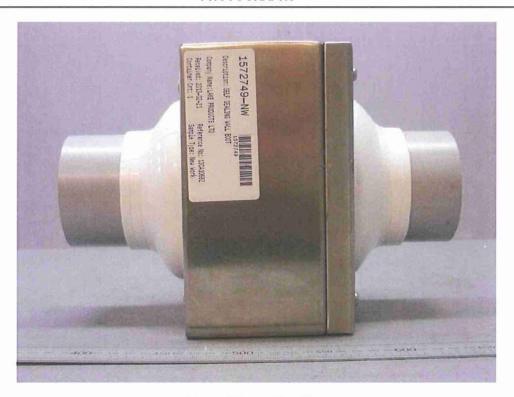


External Upper Side View

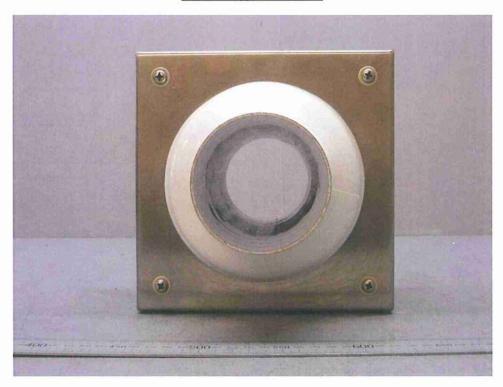

**External Front View** 



Page: 12 of 18

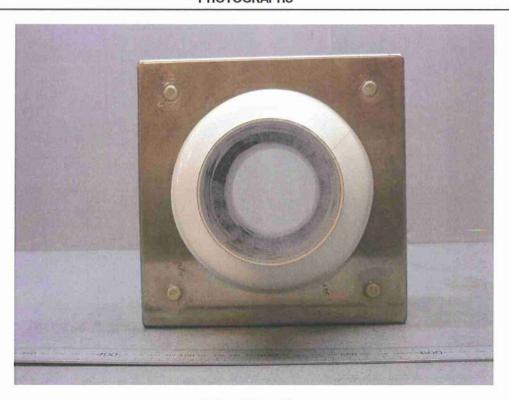


External Rear View



Internal View



Page: 13 of 18

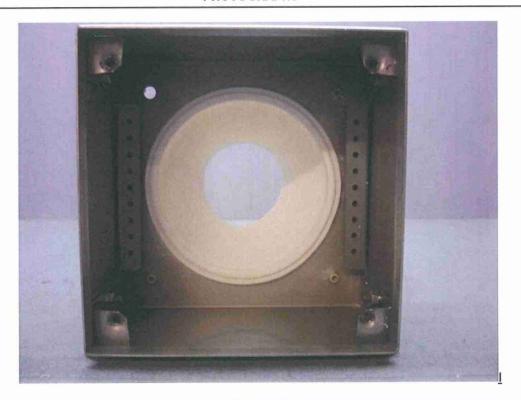

Internal View




Pipe With Wall Boot



Page: 14 of 18




External View Pipetite Grommet 0-90 Wall Boot with 50mm Pipe

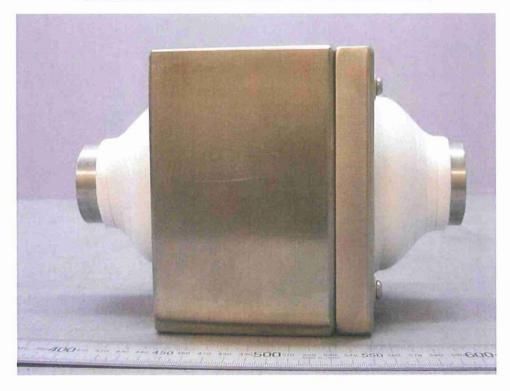

**External Side View** 



Page: 15 of 18

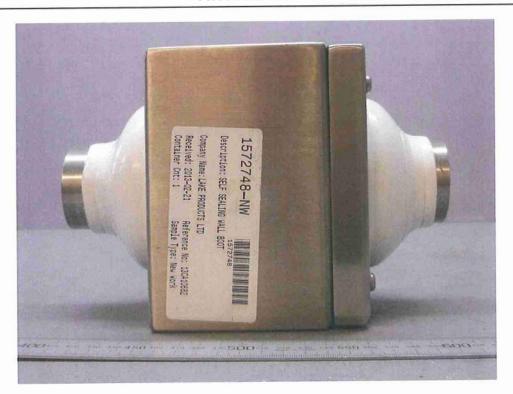

External Upper Side View




**External Front View** 



Page: 16 of 18




**External Rear View** 

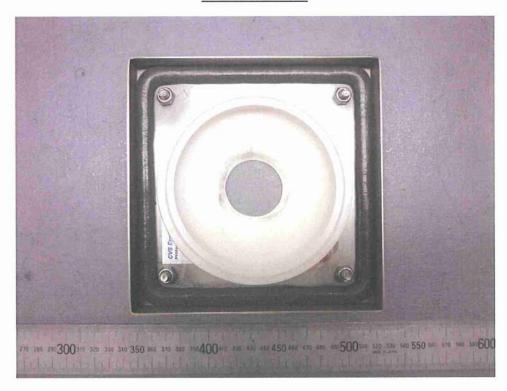

Internal View



Page: 17 of 18

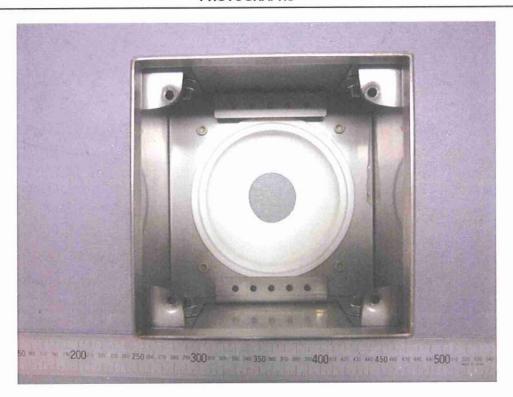

Internal View



Self Sealing Boot



Page: 18 of 18

ΕI			

No remarks.

\*\* END OF TEST REPORT \*\*